


Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature (Typical Points)

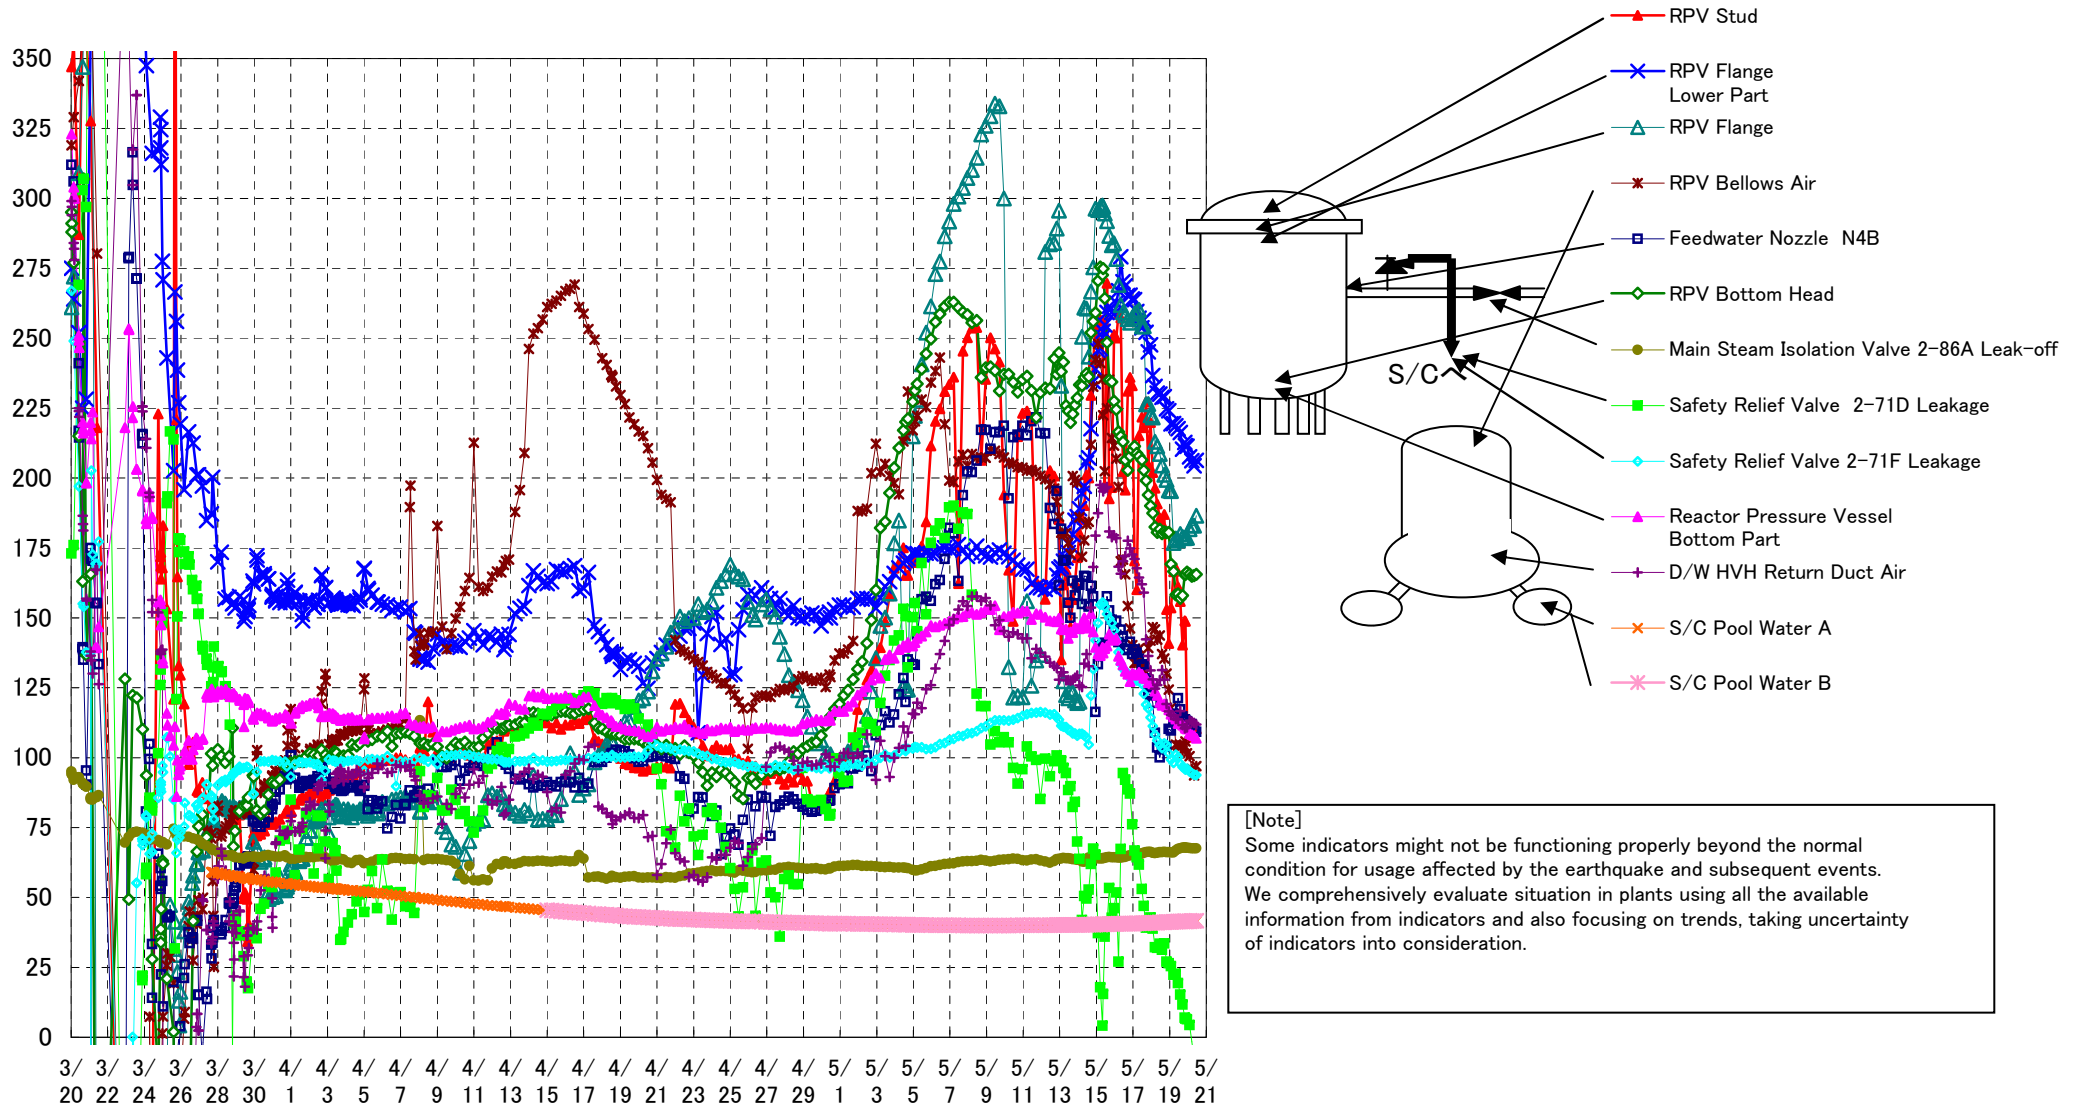

Fukushima Daiichi Nuclear Power Station Unit3 Parameters of Temperature

[Note]

Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events. We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

Date	Feedwater Nozzle N4B	RPV Bottom Head	RPV Flange	Reactor Pressure Vessel Bottom Part	RPV Stud	RPV Flange Lower Part	Safety Relief Valve 2-71D Leakage	Safety Relief Valve 2-71F Leakage	Main Steam Isolation Valve 2-86A Leak-off	D/W HVH Return Duct Air	RPV Bellows Air	S/C Pool Water A	S/C Pool Water B	note
5/16 2:00	149	224.5	278.3	142.6	250.1	262.7	51.7	142.3	64.3	178.5	206.9	40.5	40.5	
5/16 5:00	141.3	216.5	269	136.2	258.6	267	27	137.7	64.2	168.3	196.8	40.5	40.6	
5/16 8:00	145.7	214.9	261.8	134.7	257.3	279.1	67.3	133.5	64.2	165.8	170.3	40.5	40.6	
5/16 11:00	143.4	212.9	259.2	133.2	202.3	270.2	94.5	131.8	64.3	170.3	170.8	40.6	40.6	
5/16 14:00	138.9	206.4	258.2	130.9	195.7	268.7	92.1	131	64.5	172.1	165.6	40.6	40.6	
5/16 17:00	138.4	202.8	256.8	129.8	231	265.3	88.6	130.1	64.8	177.6	154.2	40.6	40.7	
5/16 20:00	141.4	207.8	255.5	127.2	236	265.4	87.1	128.3	65	174.8	146.2	40.6	40.7	
5/16 23:00	137.1	210	257.4	130.2	233	264	76.1	127.2	65.2	172.6	140.3	40.7	40.7	
5/17 2:00	138.6	211.4	258.7	129.7	170.4	263.8	66.7	128.7	65.4	171	133.8	40.7	40.7	
5/17 5:00	137.5	208.8	259.3	129.5	160.1	259.5	64.3	127.5	65.5	167.7	133.8	40.7	40.8	
5/17 8:00	135.3	207.8	260.1	130.5	215.1	257.1	61.7	127.6	65.7	164.4	139	40.7	40.8	
5/17 11:50	133.2	206.4	254.2	129.8	221.8	253.7	53	126.4	65.6	162	133.2	40.8	40.8	
5/17 14:00	133.2	202.8	254.3	128.5	218	256.6	46.9	122.8	65.9	159	133.1	40.8	40.8	
5/17 17:00	128.4	199.1	226.3	128.3	227.3	252.1	39.1	118.9	66.2	142.3	130.5	40.8	40.9	
5/17 20:00	123.1	193.9	226.5	126.8	204.7	245.1	41	117.6	66.3	136.4	139.2	40.9	40.9	
5/17 23:00	122.3	190	222.5	126.8	219.8	247.6	42.8	114.4	66.3	131.2	141.8	40.9	40.9	
5/18 2:00	119.5	187.4	221.7	126.4	202	236.6	38.8	111.3	66	128	146.7	40.9	41	
5/18 5:00	108.9	182.5	212.9	123.8	196.3	232.8	32.2	108.2	65.8	124.7	145.9	40.9	41	
5/18 8:00	103.6	180.6	211.3	122.3	190.7	230.3	31.9	106.1	66	125.9	142.2	41	41	
5/18 11:00	100.1	181.7	208.6	119.8	185.7	230	33.4	104.5	66.2	127.8	143.7	41	41.1	
5/18 14:00	103.9	180.1	204.5	118.7	183.9	228.9	31.2	103.4	66.2	131.3	137.1	41	41.1	
5/18 17:00	104.1	180.8	201.2	119.2	187	229.1	33.6	105.1	66.3	127.9	135.4	41	41.1	
5/18 20:00	104	180.4	199.3	118.3	153	224.7	27	104.5	66.2	119.2	130.1	41.1	41.2	
5/18 23:00	110.2	180.5	195.5	117.1	140.8	224.1	26.5	101.6	66.2	116.6	124.3	41.1	41.2	
5/19 2:00	109.7	169.2	195.3	115.5	153.5	219.4	25.4	99.3	66.1	115.3	117.8	41.2	41.2	
5/19 5:00	113.4	166.6	176.8	114.6	166.5	219.5	22.3	98.1	66.1	114.9	114.5	41.2	41.3	
5/19 8:00	115.6	158.2	178.4	113.8	167.7	218.7	22.7	101.1	66.8	113.8	104.7	41.3	41.3	
5/19 11:00	121.2	158.6	177.7	112.2	161.1	217.7	19.4	100.2	67.3	113.7	104.3	41.3	41.4	
5/19 14:00	117.2	157	180	112.2	155.8	216.3	15.2	97.9	67.6	116.7	104.5	41.3	41.4	
5/19 17:00	114.7	158	178.9	111.6	140.2	210.3	11.7	96.6	67.8	111.6	102.6	41.4	41.4	
5/19 20:00	113.6	165.4	178.5	111	149	212.7	7	96.1	67.9	110.5	104.1	41.4	41.5	
5/19 20:40	113.5	165.6	178.6	110.5	148.7	211.6	6.6	95.7	67.8	110.7	105.8	41.4	41.5	
5/19 23:00	113	166.3	178.6	110.3	113	211.3	6.4	96.1	67.8	110.8	101.6	41.5	41.5	
5/20 2:00	111.1	165.7	181.7	108.6	107.6	207.6	4.3	95	67.7	113.2	100.5	41.5	41.5	
5/20 5:00	112	164.9	183.1	108.2	107.6	206.2	-1.6	94.5	67.6	112.9	95.9	41.5	41.6	
5/20 8:00	110	165.1	183	107.8	107.3	204.4	-7.6	93.9	67.6	112.4	93.7	41.6	41.6	
5/20 11:00	109.2	165.6	186.5	106.9	110.2	206.3	-12.8	93.8	67.6	111.9	97	41.6	41.7	